



ALL RIGHTS RESERVED. NO PORTION OF THIS PUBLICATION, WHETHER IN WHOLE OR IN PART CAN BE REPRODUCED WITHOUT THE EXPRESS WRITTEN CONSENT OF SPC TECHNOLOGY.



SPC-F005.DWG

REVISIONS

DOC. NO. SPC-F005 * Effective: 7/8/02 * DCP No: 1398

DCP #	REV	DESCRIPTION	DRAWN	DATE	CHECKD	DATE	APPRVD	DATE
1349	A	Released	JWM	11/25/01	JC	9/6/02	DJC	9/6/02


- Hospital Grade outlets
- 14/3 SJT white cord with Hospital Grade plug
- Resettable overload circuit breaker
- Meets UL 1363 standards
- 15 Amp 125 Volts
- Aluminum housing with white finish
- Two year warranty



15 FT, 14/3, SJT, WHITE CORD WITH
A 5-15HGP MOLDED PLUG

15 AMP CIRCUIT BREAKER

Unit can be mounted in any position.
Includes 2 mounting clips which snap onto a track on
the back of the unit. Screws are included

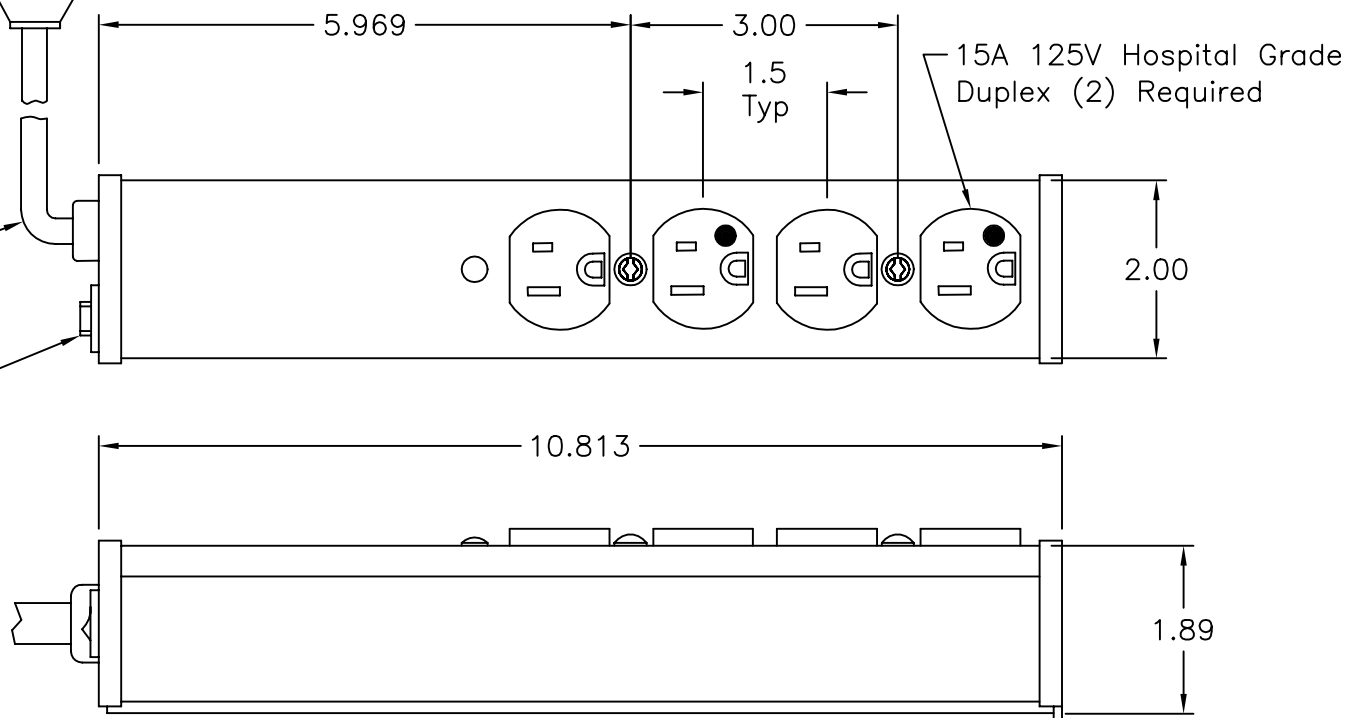

Important: NOT for use in critical care environments!

DISCLAIMER:
ALL STATEMENTS AND TECHNICAL INFORMATION CONTAINED
HEREIN ARE BASED UPON INFORMATION AND/OR TESTS WE
BELIEVE TO BE ACCURATE AND RELIABLE. SINCE
CONDITIONS OF USE ARE BEYOND OUR CONTROL, THE
USER SHALL DETERMINE THE SUITABILITY OF THE PRODUCT
FOR THE INTENDED USE AND ASSUME ALL RISK AND
LIABILITY WHATSOEVER IN CONNECTION THEREWITH.

TOLERANCES:

UNLESS OTHERWISE
SPECIFIED,
DIMENSIONS ARE
FOR REFERENCE
PURPOSES ONLY.

DRAWN BY:

Jeff McVicker

DATE:

11/12/01

CHECKED BY:

John Cole

DATE:

9/6/02

APPROVED BY:

Daniel Carey

DATE:

9/6/02

DRAWING TITLE:

Medical Group Plug-In Outlet Center Unit

SIZE

A

DWG. NO.

SPC11112

ELECTRONIC FILE

32C2089.dwg

REV

A

SCALE: NTS

U.O.M.: INCHES [mm]

SHEET: 1 OF 1