

MINI MIC REC. AND TAB CONTACT FOR SINGLE WIRE SEALING

SCOPE

This specification covers the requirements for application of Mini Mic Rec. and Tab Contacts. P/Ns involved are listed in the table of Fig. 7.

GENERAL

These contacts are suitable for 0.35-2.5sqmm wire, with single wire seals.

Each wire is inserted into a discrete wire seal before to be crimped into the contact.

The insulation barrel is crimped so that the wire seal is gripped in order to avoid any movement of the seal.

The contacts are suitable for single wire only.

The indications on the figures are valid for both receptacle and tab contacts.

1. CRIMPING

The following information contains nomenclature, crimping conditions, crimp data for mini-applicators, insertion of wire seals on cables, mending or replacement of parts and checks.

YOU ON CONDITION THAT NO FURTHER DISCLOSURE IS MADE BY YOU TO OTHER THAN AMP PERSONNEL WITHOUT WRITTEN AUTHORIZATION FROM AMP ITALIA S.P.A.

F2	Revised For ET00-0416-99	M.P./R.D.						
F1	REVISED ET00-0084-93	M.G.	16/10/93					
F	ET 00 0488-97	<i>[Signature]</i>	19/10/91	O. CANUTO	19 <sup>th</sup> Dec. 91	<b>AMP</b>	AMP ITALIA S.p.A. Corso F.lli Cami, 15 COLLEGNO (TORINO)	
E	REVISED EC ET00-0154-97	P.S.	31/4/97	CHK	<i>[Signature]</i>			19 <sup>th</sup> Dec 1991
D	REVISED PER ECN ET00-0294-95	S.S. G.C.	12 DEC 1995	APP.	<i>[Signature]</i>	23/10/92	LOC I	NO 114-20045
C	Added w.r. 1,5÷2,5sqmm	S.I. C.P.	5-11-93	ET00	0138-93			REV. F2
B	Up-dated & RELEASED	23-10- AB 92	ECN AB 92	SHEET	NAME	APPLICATION SPECIFICATION FOR MINI MIC CONTACT WITH SINGLE WIRE SEALING		
A	Revised (ECN I3009)	O.C.	19-2-92	1 OF	6			
REV LTR	REVISION RECORD	DR	DATE					

## 1.1 NOMENCLATURE

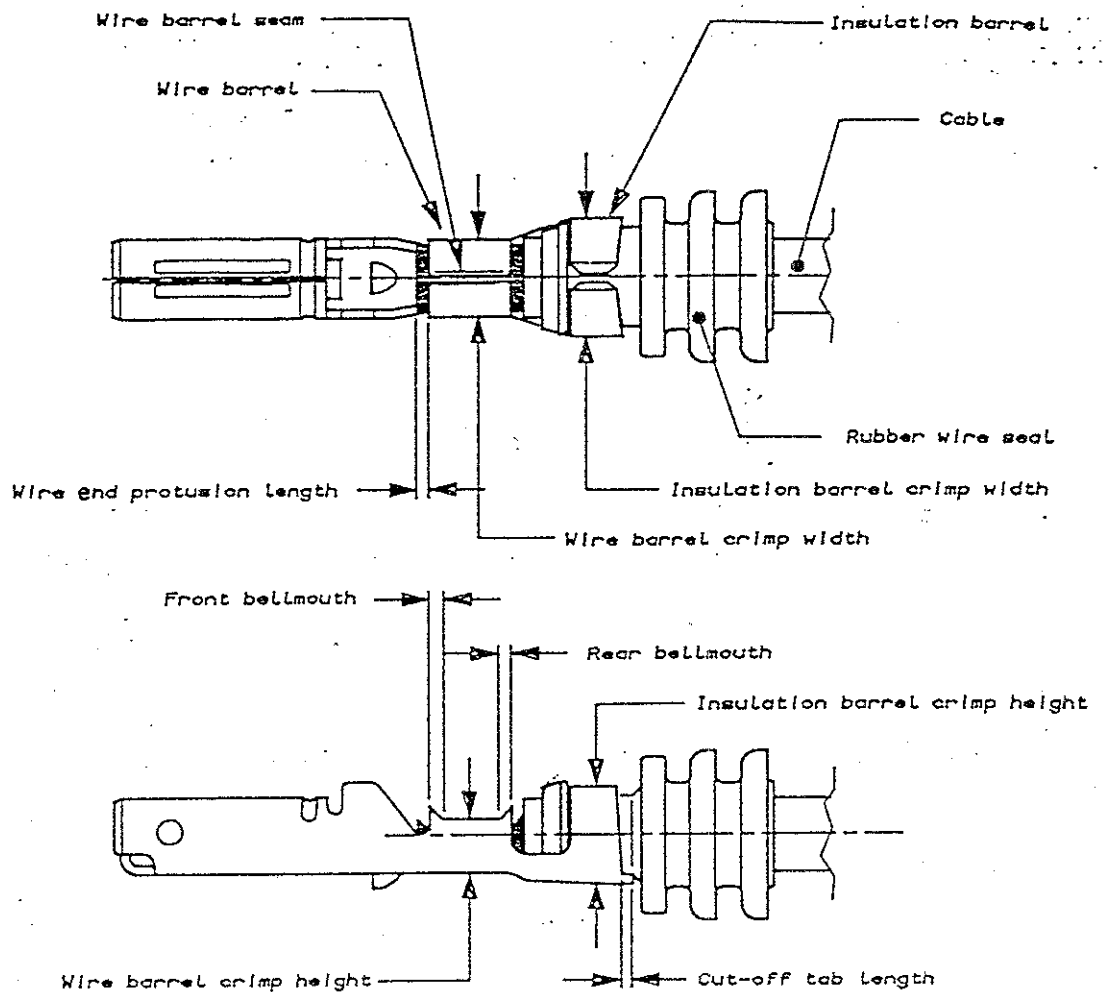


Fig. 1

## 2. CRIMPING CONDITIONS

Refer to nomenclature (Par. 1.1) see Fig. 1  
Fig. 2 and Fig. 3.

- |  |                |
|--|----------------|
| 1. Cut-off tab length                      | 0,3 mm max     |
| 2. Front bellmouth                         | 0,10 x 45° max |
| Rear bellmouth                             | 0,25x60° min   |
| 3. Bend up                                 | 5° max         |
| Bend down                                  | 5° max         |
| Bend right                                 | 5° max         |
| Bend left                                  | 5° max         |
| Rolling                                    | 5° max         |
| 4. Cable end protrusion<br>(brush length)  | 0,2 to 0,7 mm  |
| 5. Insulation stripping<br>length          | 3,0 to 3,5 mm  |
| 6. Wire barrel seam must be neatly closed. |                |

**AMP**

AMP ITALIA S.p.A.  
Corso F.lli Cervi, 15  
COLLEGNO (TORINO)

LOC.

I

SHEET

2 of 6

NO

114-20045

REV.

F2

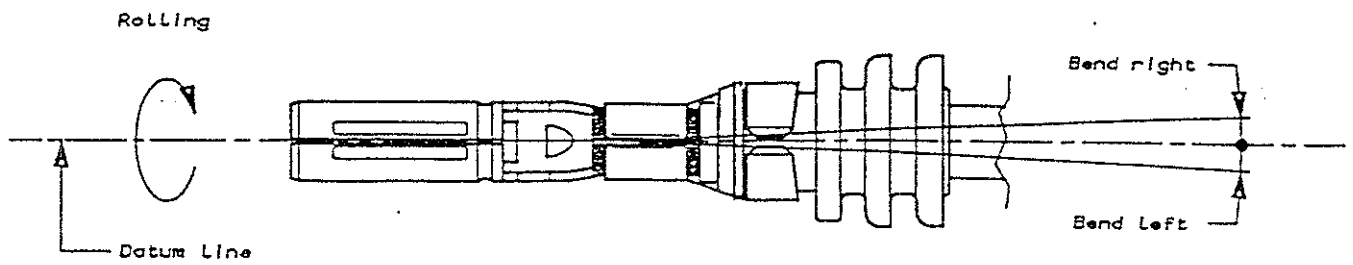


Fig. 2

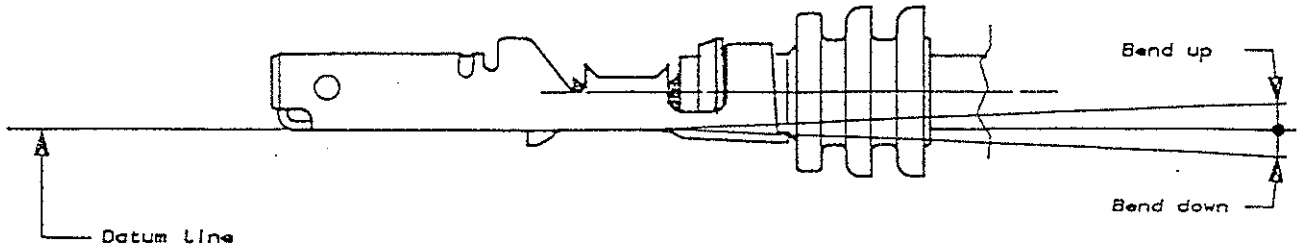


Fig. 3

### 3. CRIMP DATA

3.1 For applicator crimping see Fig. 7.

### 4. INSERTION OF RUBBER WIRE SEAL ON THE CABLE

When the rubber seal is installed on cable, the end of the cable insulation shall be positioned from the edge of the rubber seal, as shown in Fig. 4. This length is usually regardless of cable size.

NOTE: Seals are supplied lubricated. This lubrication must not be removed.

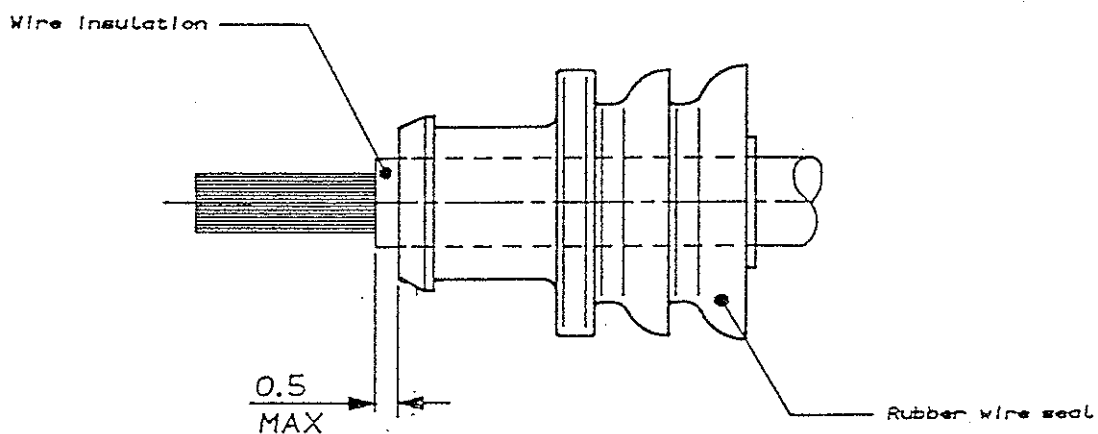


Fig. 4

**AMP**

AMP ITALIA S.p.A.  
Corso F. LUI Cervi, 15  
COLLEGNO (TORINO)

LOC.

I

SHEET

3 of 6

NO

114-20045

REV

F2

5. CORRECTION OR REPLACEMENT OF PARTS

When defects and/or improper applications are found on parts to be installed, as shown in Fig. 5, rework to set up properly, or replace with new part.








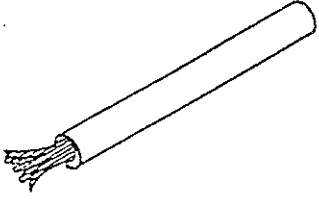
 <p>The end of the cut wire shall appear neat without any bend of stranded conductor</p>	 <p>The conductor shall be free from nick, cut and scrape.</p>	 <p>The wire insulation must have smooth surface in a round form without damage, groove or recessed surface.</p>
 <p>The end of the wire shall be straight without bend and untidiness after insertion of the wire seal. The bent wire seal be checked out</p>	 <p>The flanges of the rubber seal shall be free from cut and damage. Any seal having such defects shall be discarded, and replaced with new part:</p>	 <p>Insertion of rubber seal shall be done straightly and evenly. If flanges are in tilt condition, the plug must be corrected so that flanges are perpendicular to contact center line.</p>

Fig. 5

5.1 After crimping, the part of the cable insulation that is inside the seal shall be in good condition and within the requirements shown in Figure 5. Check by visual inspection in the transition area (between wire and insulation barrel), as indicated in Figure 6.

After crimping, the rubber seal must protrude from the insulation crimp without any damage

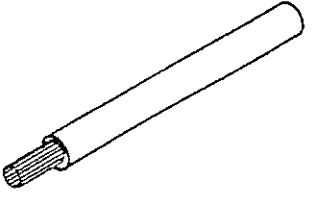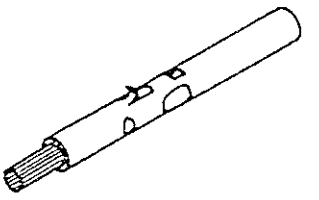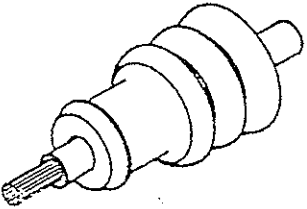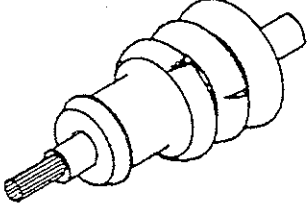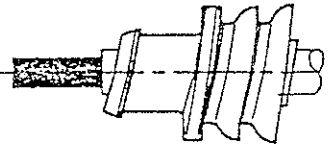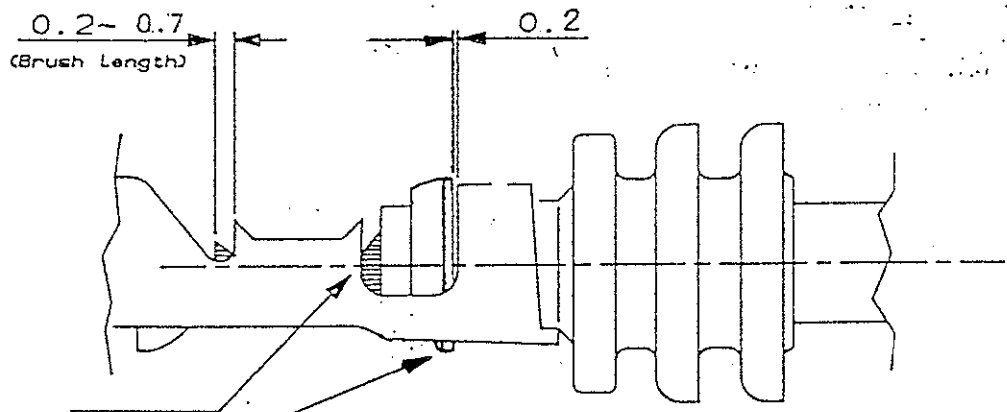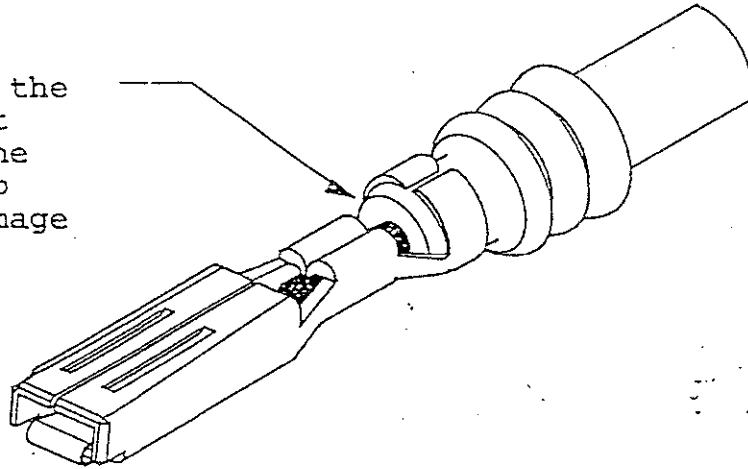

After crimping no parts of insulation or rubber in the wire crimp is allowed

Part of rubber seal must stick out from transition hole

Tilt shape of rubber wire is not allowed

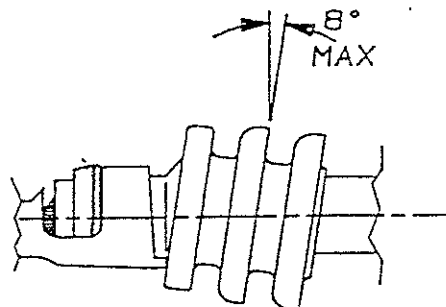


Fig. 6

5.2 Crimped contacts should appear as illustrated in Par. 1.1 (Nomenclature).

PART NO.	WIRE SIZE mmq	INS. DIA. FOR WIRE SEAL 281934-2 (TABEL. FIAT 91107/03 E 91107/05)	INS. DIA. FOR WIRE SEAL 281934-3 (TABEL. FIAT 91107/03 E 91107/05)	INS. DIA. FOR WIRE SEAL 281934-4 (TABEL. FIAT 91107/03 E 91107/05)	STRIP LENGTH	WIRE BARREL CRIMP			INSULATION BARREL CRIMP		
						CRIMPER HEIGHT ±0.05	CRIMPER WIDTH (REF)	CRIMPER TYPE	CRIMPER WIDTH (REF.)	CRIMPER TYPE	CRIMPER HEIGHT (REF.)
REC. CONTACT 282110-1	0.75 1.0 1.5	1.8-2.4	2.6-3.3	---	3.0-3.5	1.14 1.22 1.40	2.28	F	3.68	O	3.75 3.80 4.00
REC. CONTACT 282403-1	0.35 0.5	---	---	1.4-1.7	3.0-3.5	1.02 1.09	1.78	F	3.68	O	3.70 3.75
REC. CONTACT T 282466-1	1.5 2.5	1.8-2.4	2.6-3.3	---	3.5-4.0	1.72 1.98	2.28	F	4.19	O	4.00 4.40

PART NO.	WIRE SIZE mmq	INS. DIA. FOR WIRE SEAL 281934-2 (TABEL. FIAT 91107/03 E 91107/05)	INS. DIA. FOR WIRE SEAL 281934-3 (TABEL. FIAT 91107/03 E 91107/05)	INS. DIA. FOR WIRE SEAL 281934-4 (TABEL. FIAT 91107/03 E 91107/05)	STRIP LENGTH	WIRE BARREL CRIMP			INSULATION BARREL CRIMP		
						CRIMPER HEIGHT ±0.05	CRIMPER WIDTH (REF)	CRIMPER TYPE	CRIMPER WIDTH (REF.)	CRIMPER TYPE	CRIMPER HEIGHT (REF.)
FAB CONTACT 282109-1	0.75 1.0 1.5	1.8-2.4	2.6-3.3	---	3.0-3.5	1.34 1.45 1.52	2.28	F	3.68	O	3.75 3.80 4.00
FAB CONTACT 282404-1	0.35 0.5	---	---	1.4-1.7	3.0-3.5	0.99 1.04	2.03	F	3.68	O	3.70 3.75
FAB CONTACT 282465-1	1.5 2.5	1.8-2.4	2.6-3.3	---	3.5-4.0	1.72 1.98	2.28	F	4.19	O	4.00 4.40

PART NO.	WIRE SIZE mmq	INS. DIA. (TABEL. IVECO 11-8140) (PHASE 2)	INS. DIA. (TABEL. FIAT 91107/03 E 91107/05) (PHASE 3)	STRIP LENGTH	WIRE BARREL CRIMP			INSULATION BARREL CRIMP			
					CRIMPER HEIGHT ±0.05	CRIMPER WIDTH (REF)	CRIMPER TYPE	CRIMPER WIDTH (REF.)	CRIMPER TYPE	CRIMPER HEIGHT (REF PHASE 2)	CRIMPER HEIGHT (REF PHASE 3)
FAB CONTACT 284262-1	0.35 0.5 0.75	---	1.4-1.45 1.6-1.7 1.9-2.0	3.0-3.5	0.99 1.04 1.34	2.03	F	3.68	F	---	2.00 2.10 2.15
FAB CONTACT 284263-1	1.0 1.5 0.5+0.5 1.0+0.5	2.2-2.4 2.8 MAX 1.8-2.0+ 1.8-2.0 2.2-2.4+ 1.8-2.0	2.0-2.1 2.3-2.4 ---	3.0-3.5	1.45 1.52 1.45 1.52	2.28	F	3.70	F	3.55 3.75 3.70 4.00	3.25 3.30 ---

FIG. 7

"Dimensions are in mm"

<b>AMP</b>	AMP ITALIA S.p.A. Corso F.lli Cervi, 15 Collegno (TORINO)	SHEET	LOC.	NUMBER	REV.
		6 OF 6	I	114-20045	F2