

- Olympian plug-in design
- Robust and compact
- High flow unit with large valve and diaphragm
- Adjusting Knob has Snap-Action Lock
- Excellent flow and regulation characteristics

Redimount Regulator
G^{3/4} to G1^{1/2}
Olympian



Technical Data

Medium:

Compressed air only

Maximum Inlet Pressure:

20 bar

Operating Temperature:

-20°C* to +80°C

*Consult our Technical Service for use below +2°C

Recommended Regulated Pressures^{††}:

0,4 - 8 bar standard

0 - 4 bar optional

2 - 16 bar optional (only available with T-bar adjusting screw)

^{††}Can be adjusted to zero bar outlet pressure and, generally, to pressures in excess of those specified.

Gauge Ports:

G^{1/8}

Maximum Flow with 10 bar inlet pressure, 6,3 bar outlet pressure and pressure drop of 1 bar:

180 dm³/s

Port Sizes

G^{3/4}, G1, G1^{1/4}, G1^{1/2} to ISO 1179

Accepts ISO 228 (BS 2779) parallel or ISO 7 (BS 21) taper connectors

Alternative Models

Other port thread forms

T-bar adjusting screw

Maximum pressure setting stop

Key Lock adjusting knob



Materials

Aluminium alloy body. Acetal resin adjusting knob (steel T-bar adjusting screw). Synthetic rubber elastomeric materials.

Ordering Information

To order a standard Redimount Regulator, quote model number from table overleaf.


For non-standard models substitute appropriate digits as instructed.

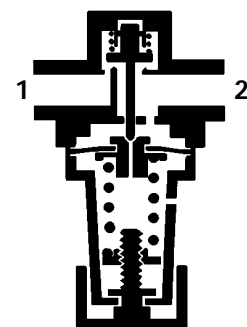




Typical Performance Characteristics

FLOW CHARACTERISTICS

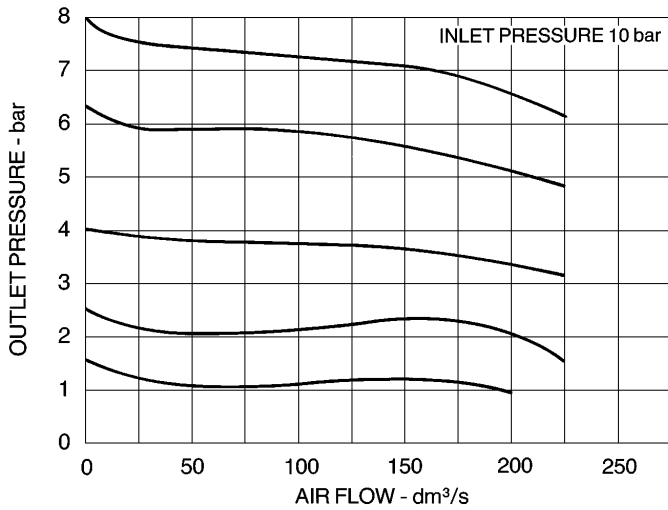

REGULATION CHARACTERISTICS

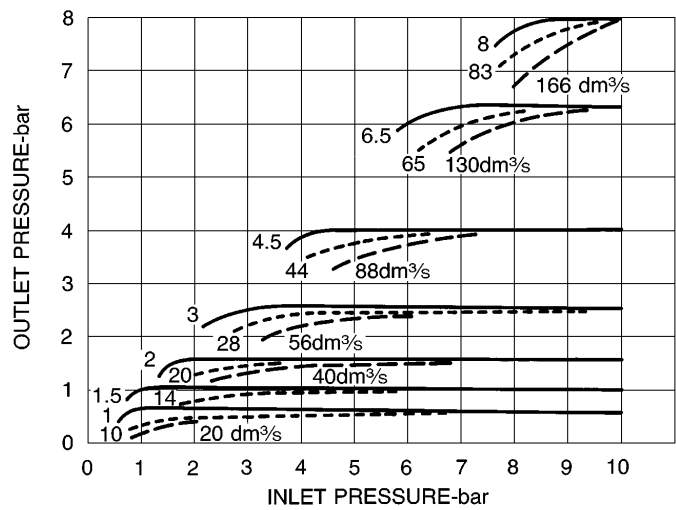

Standard Redimount Regulators

8 bar spring

Port Size	Relieving	Weight kg	Non-relieving	Weight kg
G ³ / ₄	R15-600-RNLD	2,04	R15-600-NNLD	2,14
G1	R15-800-RNLD	2,04	R15-800-NNLD	2,09
G1 ¹ / ₄	R15-A00-RNLD	2,08	R15-A00-NNLD	2,11
G1 ¹ / ₂	R15-B00-RNLD	2,12	R15-B00-NNLD	2,15

Non-standard Models

For replacement Regulators substitute '0' and 'O' at the 4th and 10th digits respectively, e.g. R15-000-RNLO. Supplied without Unidaptors as replacement units or for the build-up of Combination Units. Please consult our Technical Service for further details.

For optional 4 or 16 bar springs, substitute 'F' or 'S' respectively for 'L' at the 9th digit, e.g. R15-600-RNFD. (16 bar spring only available with T-bar adjusting screw).

For optional T-bar adjusting screw, substitute '1' for '0' at the 6th digit, e.g. R15-601-RNLD.

Specify if unit is required complete with T15 Shut-Off Valve fitted upstream. For details of Shut-Off Valves see page 8.11.021.01.

For other options, please consult our Technical Service.


Accessories

Wall Mounting Bracket Kit, see page 8.6.041.03.

Pressure Gauges, see page 8.11.031.01.




Redimount Regulator

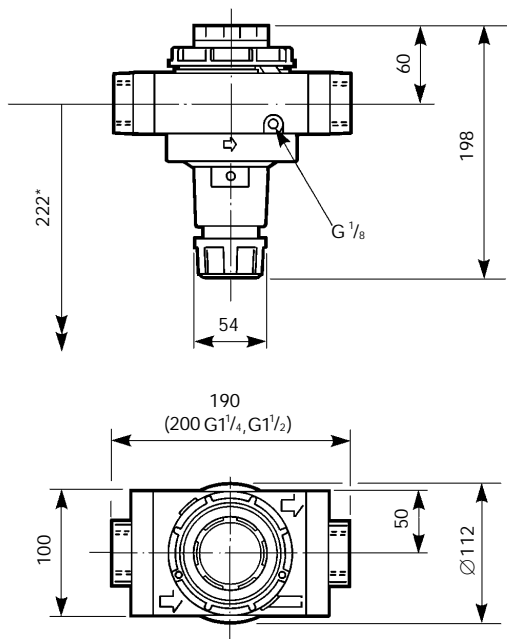


Relieving

- R15-600-RNLD G³/₄
- R15-800-RNLD G1
- R15-A00-RNLD G1¹/₄
- R15-B00-RNLD G1¹/₂




Non-relieving

- R15-600-NNLD G³/₄
- R15-800-NNLD G1
- R15-A00-NNLD G1¹/₄
- R15-B00-NNLD G1¹/₂



*Minimum clearance required to remove unit from yoke.

Bracket Mounting

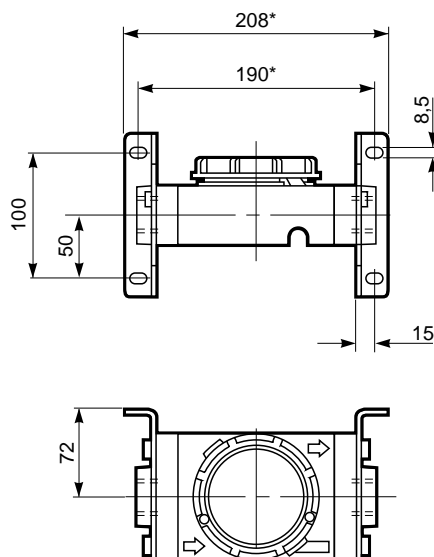

Bracket Kit reference:

- G³/₄ 18-001-979
- G1 18-001-979
- G1¹/₄ 18-001-978
- G1¹/₂ N/A

*If Shut-Off Valve fitted add 46 mm to dimensions.



Spares Kits

Type	Gasket Kit	Repair Kit
Relieving	R15-GK	R15-100R
Non-relieving	R15-GK	R15-100N

Warning

These products are intended for use in industrial compressed air systems only. Do not use these products where *pressures* and *temperatures* can exceed those listed under '**Technical Data**'.

Before using these products with fluids other than those specified, for non-industrial applications, life-support systems, or other applications not within published specifications, consult NORGREN MARTONAIR.

Through misuse, age, or malfunction, components used in fluid power systems can fail in various modes. The system designer is warned to consider the failure modes of all component parts used in fluid power systems and to provide adequate safeguards to prevent personal injury or damage to equipment in the event of such failure.

System designers must provide a warning to end users in the system instructional manual if protection against a failure mode cannot be adequately provided.

System designers and end users are cautioned to review specific warnings found in instruction sheets packed and shipped with these products.