


Wiring Diagram for
 fainell Order Code
 916-341


Wiring Diagram

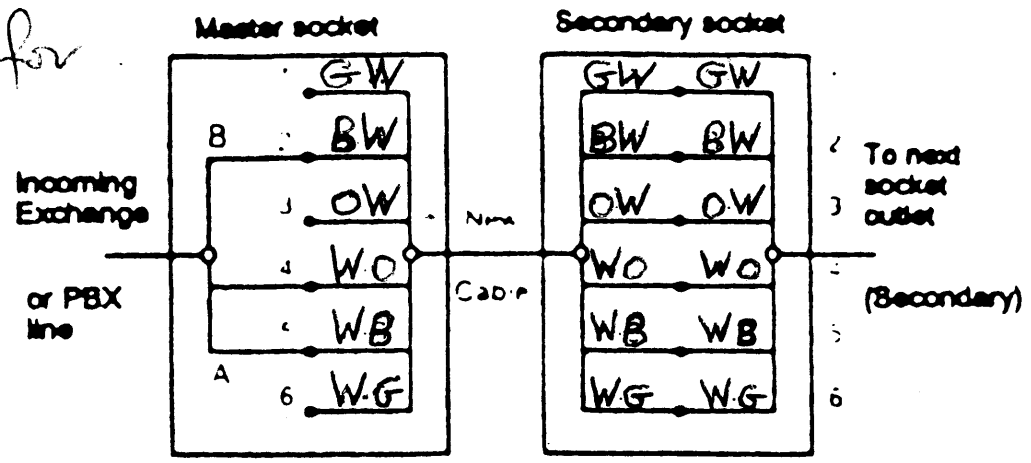

Note

Terminal 4 is used only on a PBX line for "Earth Recall"


Old in-house cable (subscribers cable) can be connected as follows

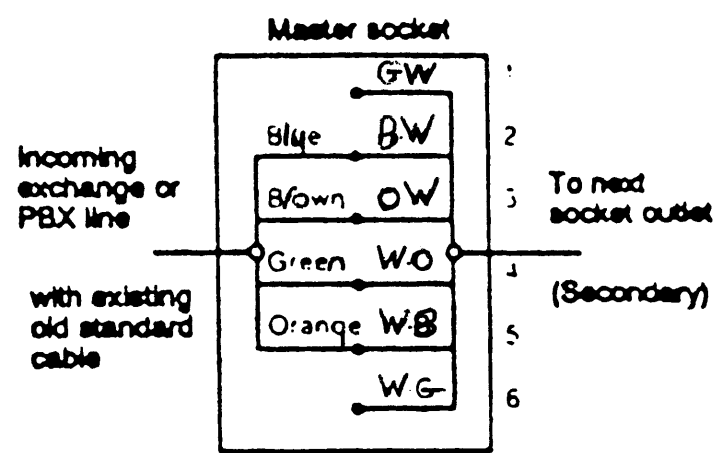

Note

A Terminals 1 and 6 are frequently unused, 2 pair (4 wire) cable is normally used in these installations.

B. All wiring is parallel, i.e. Terminal 1 on Master Socket to Terminal 1 on Secondary Socket, Terminal 2 to Terminal 2, etc...

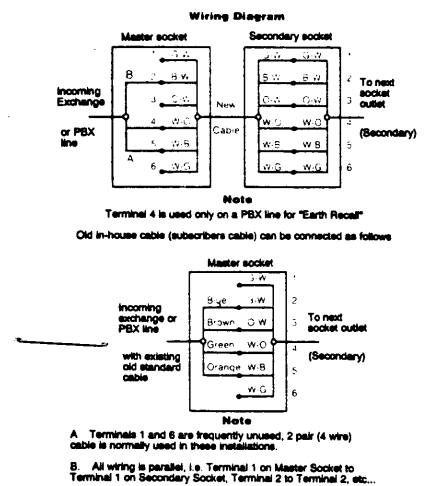

A Terminals 1 and 6 are frequently unused, 2 pair (4 wire) cable is normally used in these installations.
 B. All wiring is parallel, i.e. Terminal 1 on Master Socket to Terminal 1 on Secondary Socket, Terminal 2 to Terminal 2, etc...